

EVOCHARGE®

EVOCHARGE® Integrated Pedestal

User Installation Guide

Revision A



Retractor with EVC50A



Retractor with Max 80A

Maintenance and Safety:

IMPORTANT SAFETY INSTRUCTIONS - PLEASE DO NOT DISCARD THESE INSTRUCTIONS

READ THE INSTRUCTIONS COMPLETELY. FAILURE TO FOLLOW INSTALLATION INSTRUCTIONS MAY RESULT IN PROPERTY DAMAGE, INJURY, OR DEATH. THE MANUFACTURER ASSUMES NO LIABILITY FOR CLAIMS RESULTING FROM THIS.

DANGERS, WARNINGS, CAUTIONS, AND NOTICES ARE DEFINED PER ANSI Z535



DANGER: TO AVOID FIRE, SHOCK, OR DEATH: TURN OFF POWER AT CIRCUIT BREAKER OR FUSE AND TEST THAT POWER IS OFF BEFORE WIRING



WARNING: ELECTRIC SHOCK: NO OPERATOR SERVICEABLE PARTS INSIDE. REFER SERVICING TO QUALIFIED PERSONNEL



WARNING: VERIFY WITH LOCAL AUTHORITIES THAT THE LOCATION WHERE THE PEDESTAL IS TO BE INSTALLED IS FREE FROM UNDERGROUND PIPELINES OR ELECTRICAL EQUIPMENT



WARNING: DO NOT USE THIS PRODUCT IF INPUT POWER WIRES IS FRAYED, BROKEN INSULATION, OR ANY OTHER SIGNS OF DAMAGE



CAUTION: THE ELECTRICAL VEHICLE SUPPLY EQUIPMENT (EVSE) PEDESTAL MUST BE WIRED PER THE NATIONAL ELECTRICAL CODE (NEC) AND LOCAL CODES



CAUTION: THE EVSE CHARGING STATION AND ELECTRICAL WIRING SHOULD BE INSTALLED BY AN ELECTRICIAN IN ACCORDANCE WITH THE LOCAL ELECTRICAL CODES AND REGULATIONS



CAUTION: GROUNDING: TO ENSURE THE SAFE OPERATION OF THE PEDESTAL, IT MUST BE CONNECTED TO A GROUNDING CIRCUIT COMPLIANT WITH LOCAL BUILDING CODES



CAUTION: HANDLE PARTS WITH CARE. ALWAYS USE PROPER PERSONAL PROTECTIVE EQUIPMENT (PPE) DURING THE INSTALLATION

NOTICE

RUN DEDICATED BRANCH CIRCUITS (ONE BREAKER PER EVSE CHARGING STATION), AS PER NEC 625 AND LOCAL BUILDING CODES

NOTICE

WHEN MOUNTING THE PEDESTAL IN PARKING SPACES OR PARKING GARAGES, APPROPRIATE ANTI-COLLISION PROTECTION MUST BE INSTALLED. REFERENCE LOCAL BUILDING CODES

NOTICE

TO ENSURE THAT THE EVSE CHARGING STATION AND PEDESTAL ARE INSTALLED PER AMERICANS WITH DISABILITIES ACT (ADA) STANDARDS FOR ACCESSIBLE DESIGN GUIDELINES, REFER TO CODE OF FEDERAL REGULATIONS DOCUMENT 28 CFR PART 36, SECTIONS 4.2 AND 4.4


NOTICE

IF YOU HAVE QUESTIONS ABOUT THE INSTALLATION, CONTACT EVOCHARGE TECHNICAL SUPPORT. IF YOU ARE UNSURE ABOUT A PROCEDURE DO NOT ATTEMPT TO PERFORM IT

NOTICE

THIS INSTALLATION INSTRUCTIONS SOLELY FOR THE PEDESTAL. DEPICTIONS OF THE EVOCHARGE EVSE ARE FOR REFERENCE ONLY. REFER TO THE EVOCHARGE EVSE INSTALLATION MANUAL INCLUDED WITH CHARGER UNIT OR AVAILABLE ON EVOCHARGE.COM



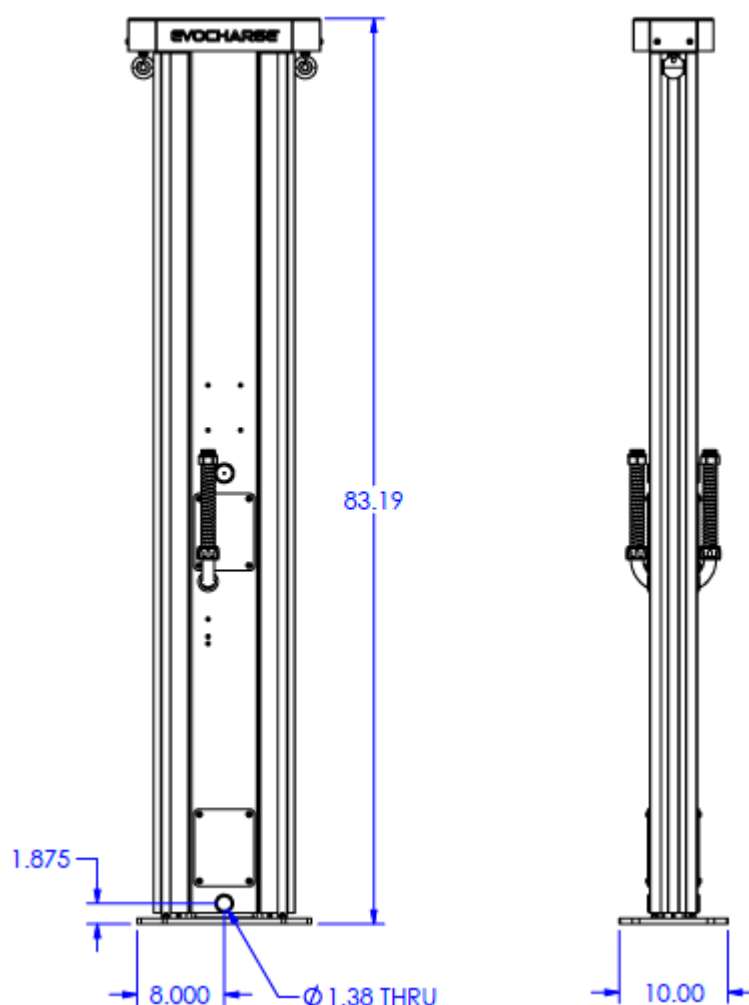



Technical Data and Specifications

Standards and Certifications:

Compliant with Americans with Disabilities Act (ADA) recommended charger connect height of less than 48" and greater than 24"

Description	Specification
Weight lbs. [kg]	
Pedestal	99.579 [45.17]
Enclosure	
Material	Aluminum

Approximate Dimensions Inches [mm]	
Height x Width x Depth	83.19 [2113.03] x 17.68 [449.07] x 10 [254]
Wall Thickness	0.45 [11.53]
Distance Between Center of Mounting Holes	12.5 [317.5] x 6.825 [173.36]

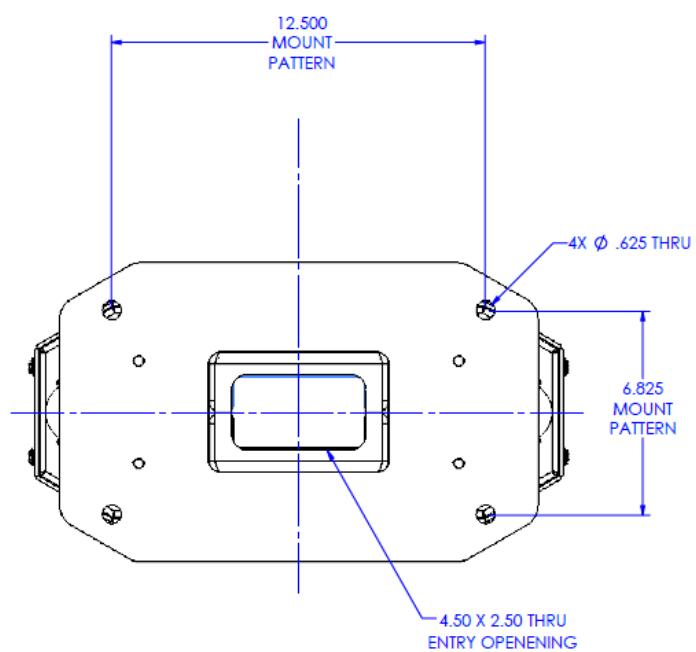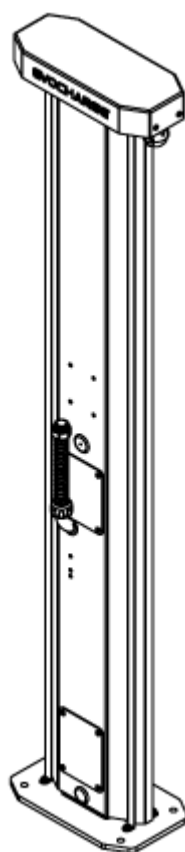

Pedestal Installation

Anchor and Conductor Installation Wet Concrete:

The installer should use stainless steel L or J type anchor bolts with a diameter no greater than $\frac{1}{2}$ inch. Reference Figure 2 for bolt spacing.




Fig. 1: Concrete Anchors Configuration

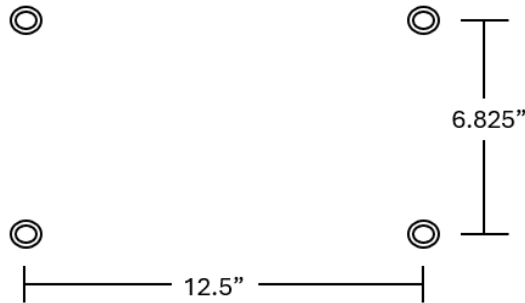


Fig. 2: Bolt Spacing

The requirements below are the manufacturer's minimum recommendations only. The location, dimensions, and composition of the concrete pad for supporting the pedestal should always comply with local building codes.

Use an electrical conduit of the appropriate size to bring the electrical cables to the center of the concrete anchors. Pull conductors from the service equipment to the pedestal installation site, leaving 5 feet of wire exposed. Reference Figure 3.

Hex nuts and washers are to be placed on the anchor bolts below the pedestal to adjust the vertical alignment, should the concrete pad not be level. A gap will be present between the concrete pad and pedestal base. Seal the gap with silicone sealant. Apply silicone per the manufacturer's recommendations.

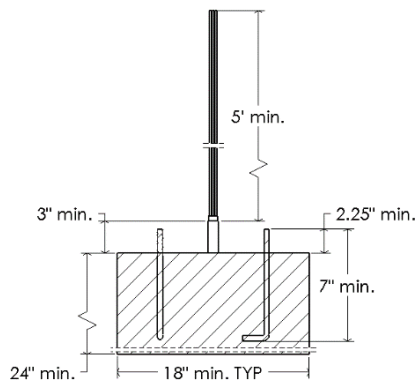


Fig. 3: Concrete Base

Grounding: Verify grounding requirements with state, local, and national electrical codes and standards.

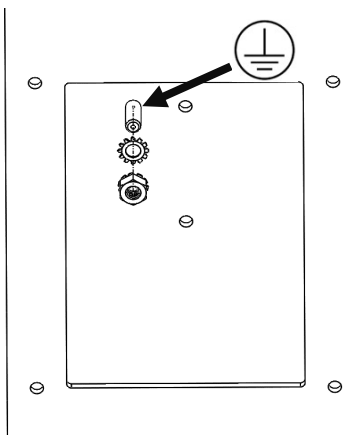


Fig. 5: Grounding Connection Configuration (Tighten Lock Nut to 45 inch-pounds)

Warranty

The EvoCharge warranty statement is located on the website at evocharge.com/warranty